


20 yrs → new units at the time } → Navigant
 20 yrs → new units at the time } → Navigant



GA cost comparison

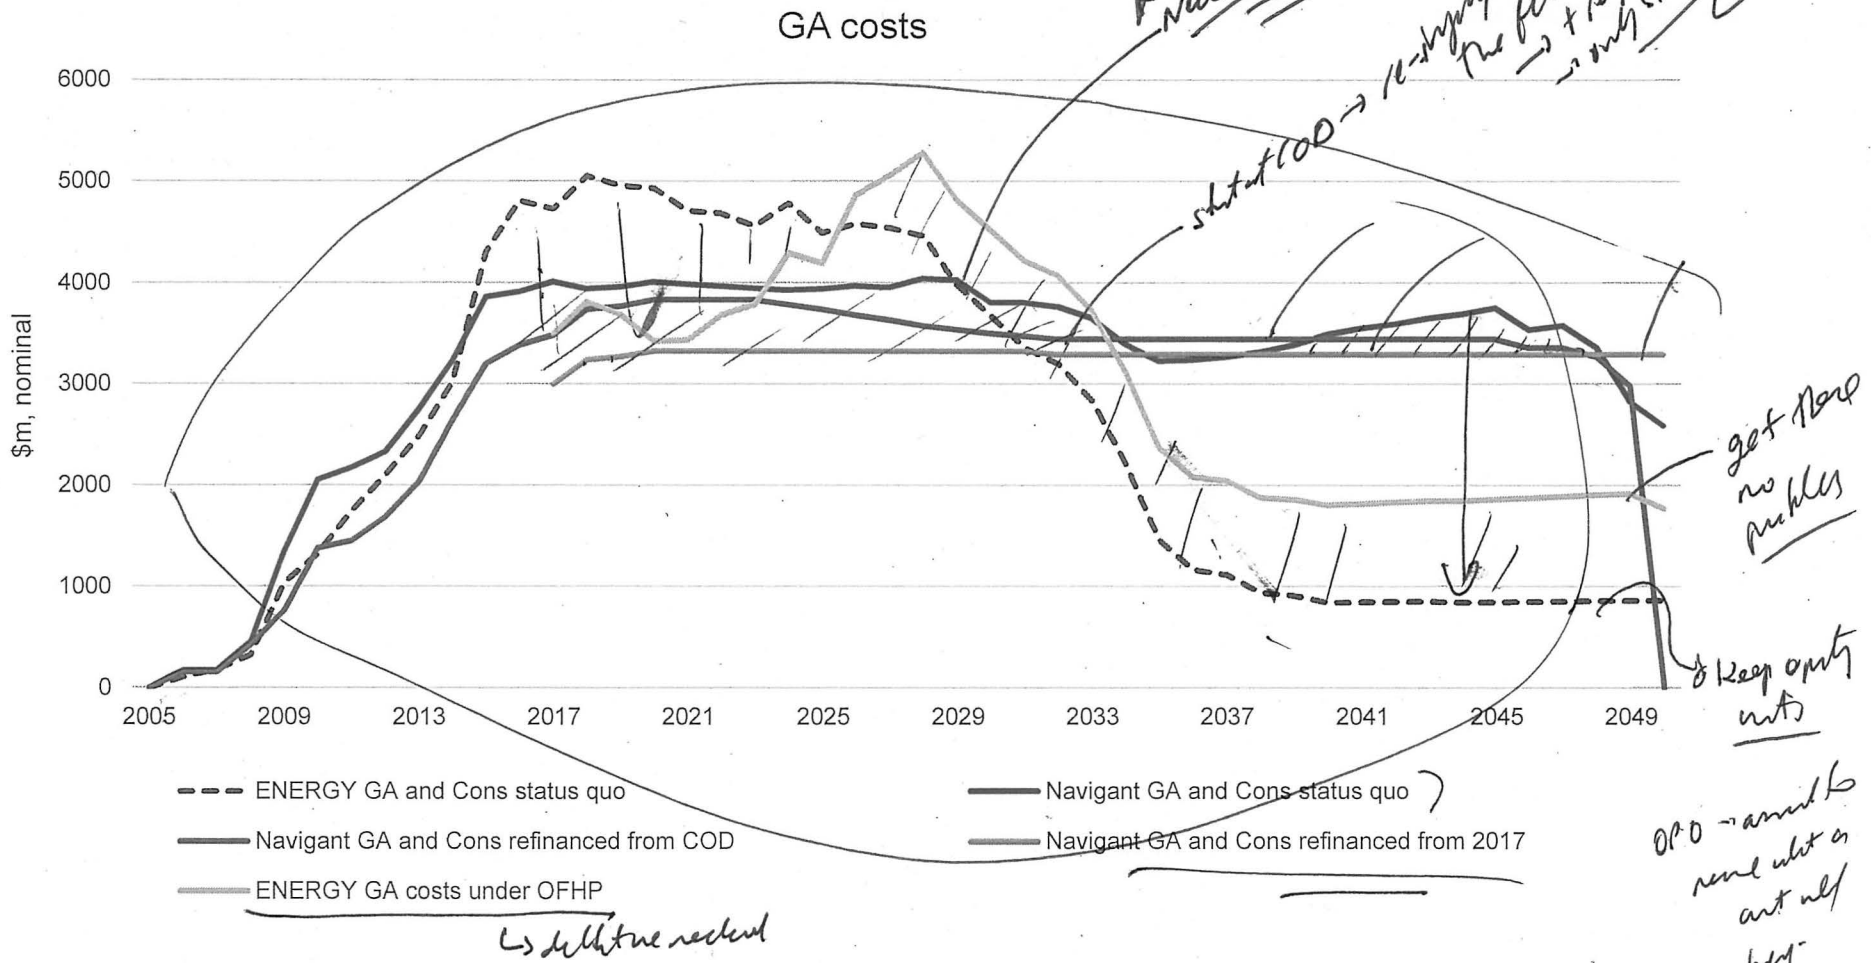

Notes: ENERGY projection assumptions plant life extended by 10 years and then retired. Navigant analysis assumes long-term repowering

How much to put - 5 more unit / but less expensive